


- 3 EA HOLES 3" OFFSET FROM WALL
- 7 EA RG-214 IN 2" STEEL CONDUIT
- 7 EA RG-214 IN 2" STEEL CONDUIT
- 2 EA RG-214 AND 1 EA 12 PR 24 AWG IN 2" STEEL CONDUIT.
- #4-0 GROUND CABLE FROM GROUNDING LUG IN 2" PVC CONDUIT.
- 4 EA HOLES OFFSET 5" FROM WALL
- FIBER OPTIC CABLE FROM ST CONNECTION IN 1" EMT CONDUIT.
- TELCO CABLE 24 AWG 25 PR FROM TT1 IN 2" EMT CONDUIT.
- 3 EA 24 AWG 25 PR CABLE FROM TO1, TO2, TO3 IN 2" EMT CONDUIT.

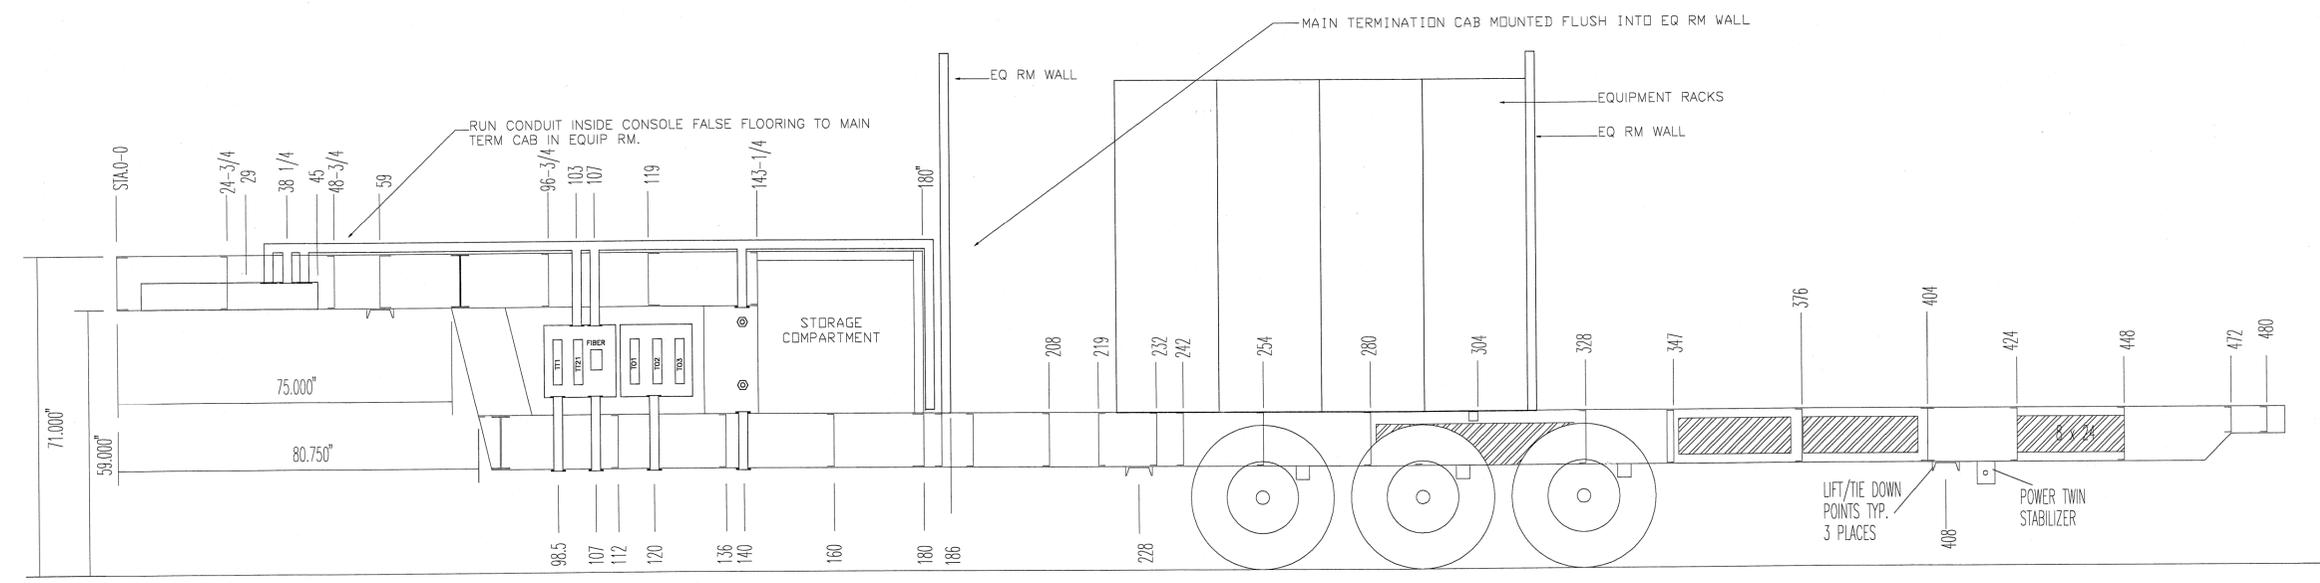

NOTE
 INSTALL CLEAR PLASTIC COVER TO TT2 TO INHIBIT TELEPHONE COMPANY ACCESS
 LEAVE TT1 UNCOVERED TO ENCOURAGE TELEPHONE COMPANY ACCESS.

REV	DATE	DESCRIPTION	CHECK	APRVD
DEPARTMENT OF TRANSPORTATION FEDERAL AVIATION ADMINISTRATION NORTHWEST MOUNTAIN REGION - SEATTLE, WASHINGTON SEATTLE, WASHINGTON MOBILE ATCT CONNECTIVITY 2				
REVIEWED BY	SUBMITTED BY		APPROVED BY	
	FRED L. TREVINO		SUPV:	
	DESIGNED: FLT	ISSUED BY	DATE 7/22/94	
	DRAWN: FLT	AIRWAY FACILITIES	DRAWING NO.	
	CHECKED:	DIVISION	NMD-601-94-08	
		ANM-400		