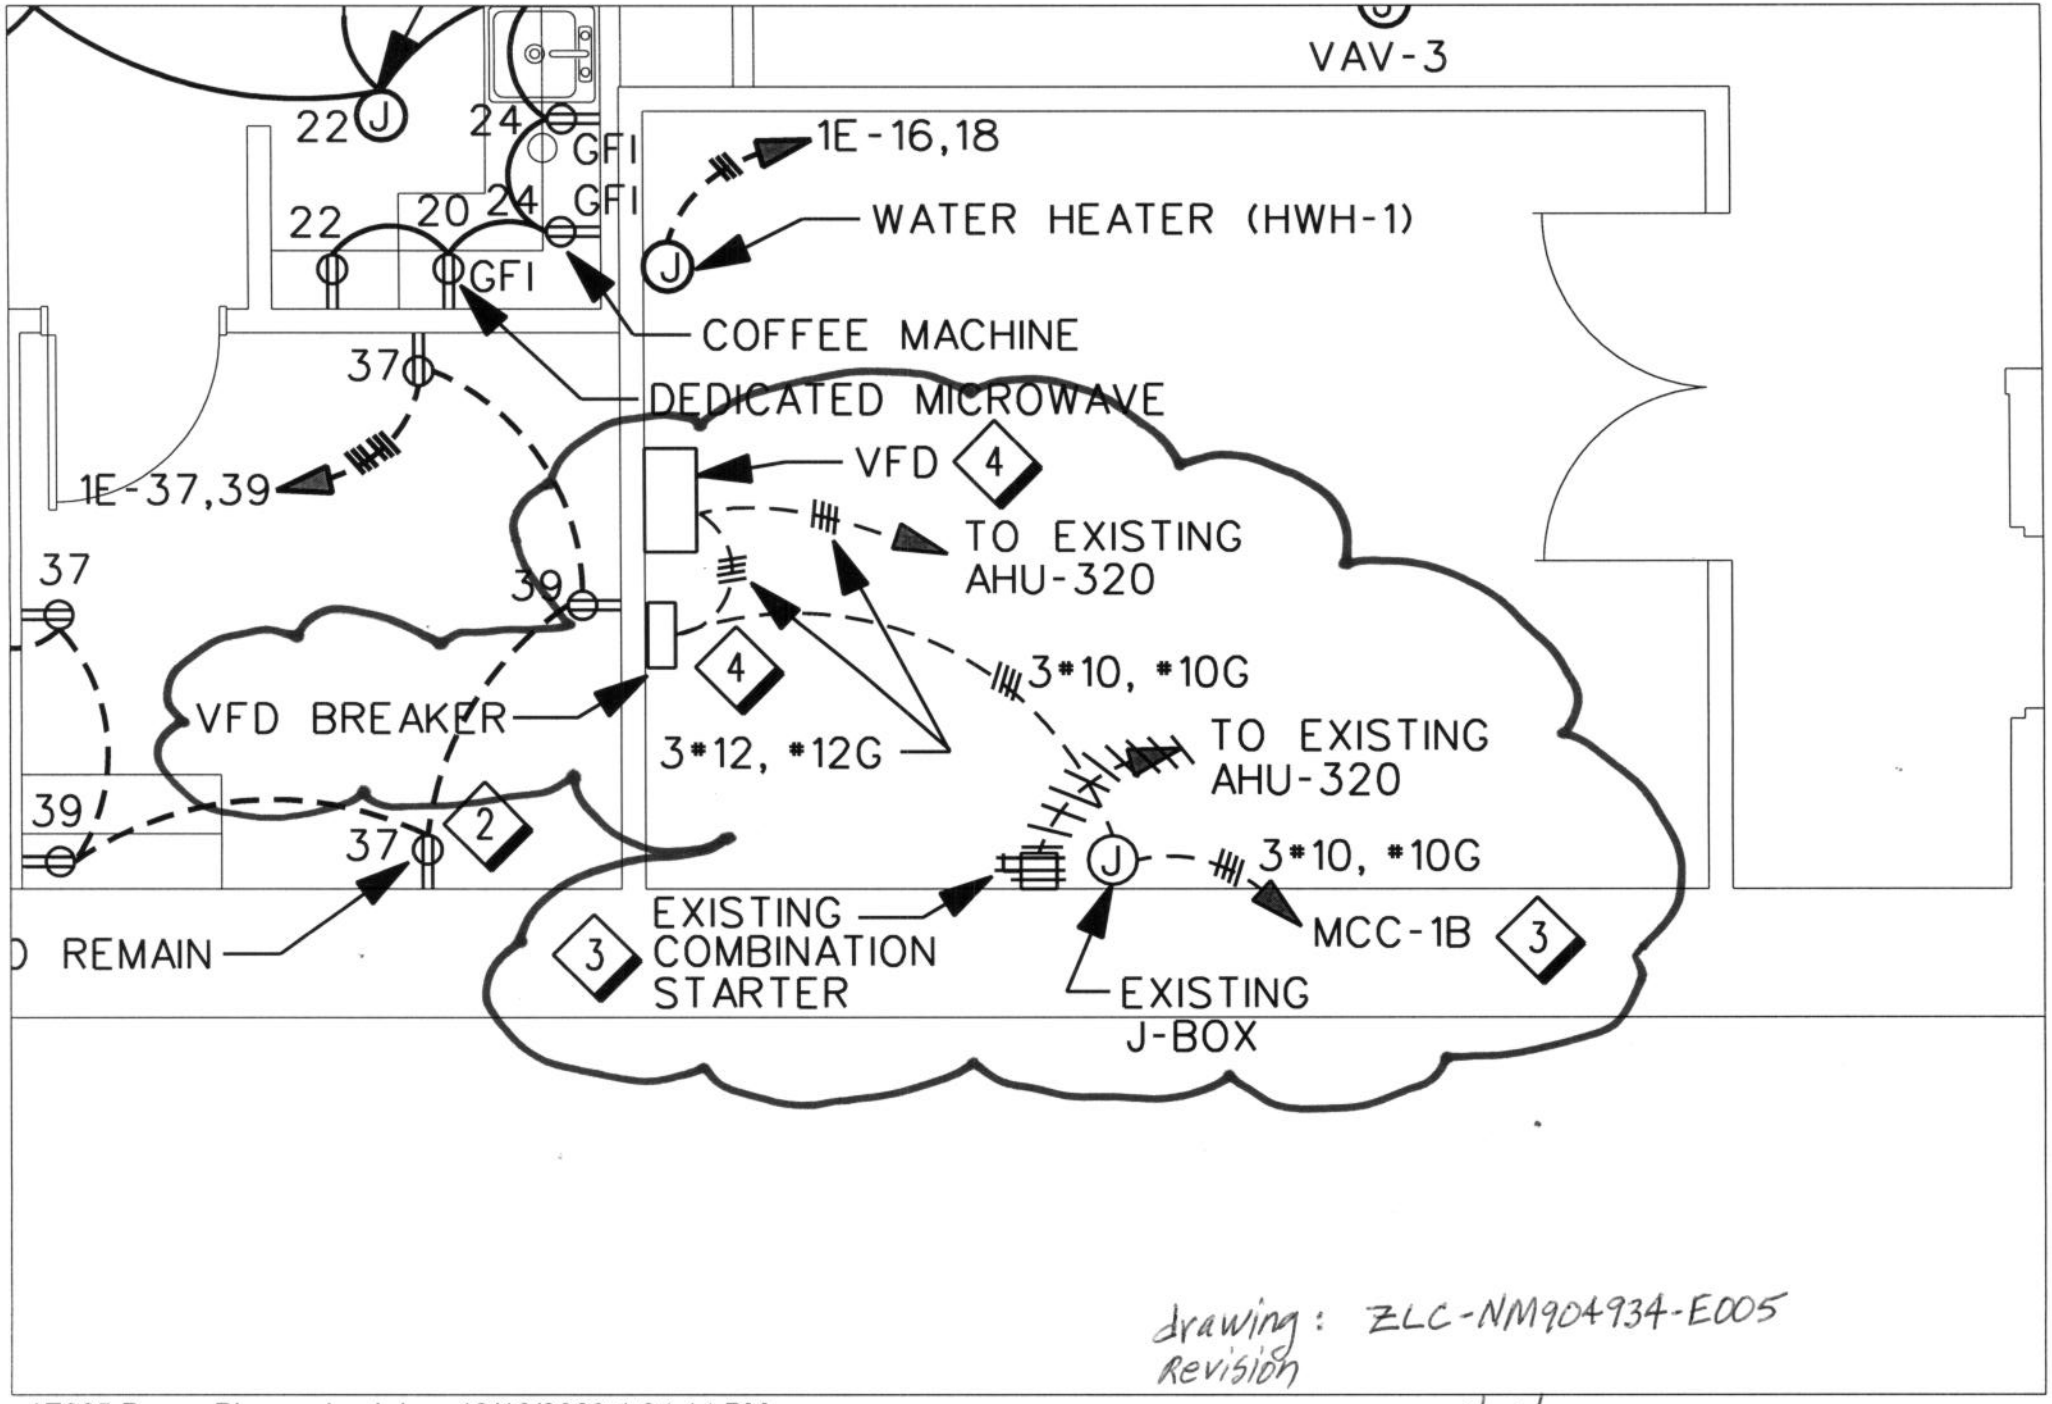

drawing: ZLC-NM904934-E005
Revision

sh 1/2

SHEET NOTES:

1. (1) BRANCHED CIRCUIT FEEDS POWER FOR TWO CUBICLE OR CONTRACTOR TO CONNECT PER SYSTEM FURNITURES RECOMMENDATION. DO NOT EXCEED NEC 2008 FOR BRANCH CIRCUITS.

2. PROVIDE NEW COVER PLATES, RECEPTACLES AND PULL NEW WIRES TO EXISTING RECEPTACLE TO REMAIN. TYPICAL FOR ALL.

3. CONTRACTOR TO REMOVE COMBINATION STARTER AND EXISTING FEEDERS ALL THE WAY TO THE POWER SOURCE (MCC-1B IN THE CHILLER ROOM). CONTRACTOR TO PULL NEW 3#10, #10G WIRES TO NEW VFD CIRCUIT BREAKER IN THE EXISTING CONDUIT.

4. NEW VFD PROVIDED BY OTHERS. ELECTRICAL CONTRACTOR TO PULL NEW WIRES FROM MCC 1B TO NEW VFD CIRCUIT BREAKER IN EXISTING CONDUIT. CIRCUIT BREAKER TO BE SIZED PER MANUFACTURER'S RECOMMENDATION.

drawing: ZLC-NM904934-E005
Revision

$NAME$ 1:35:00 PM 12/16/2009

B

A

...\E005 Power Plan-revised.dgn 12/16/2009 1:35:00 PM

sh 2/2