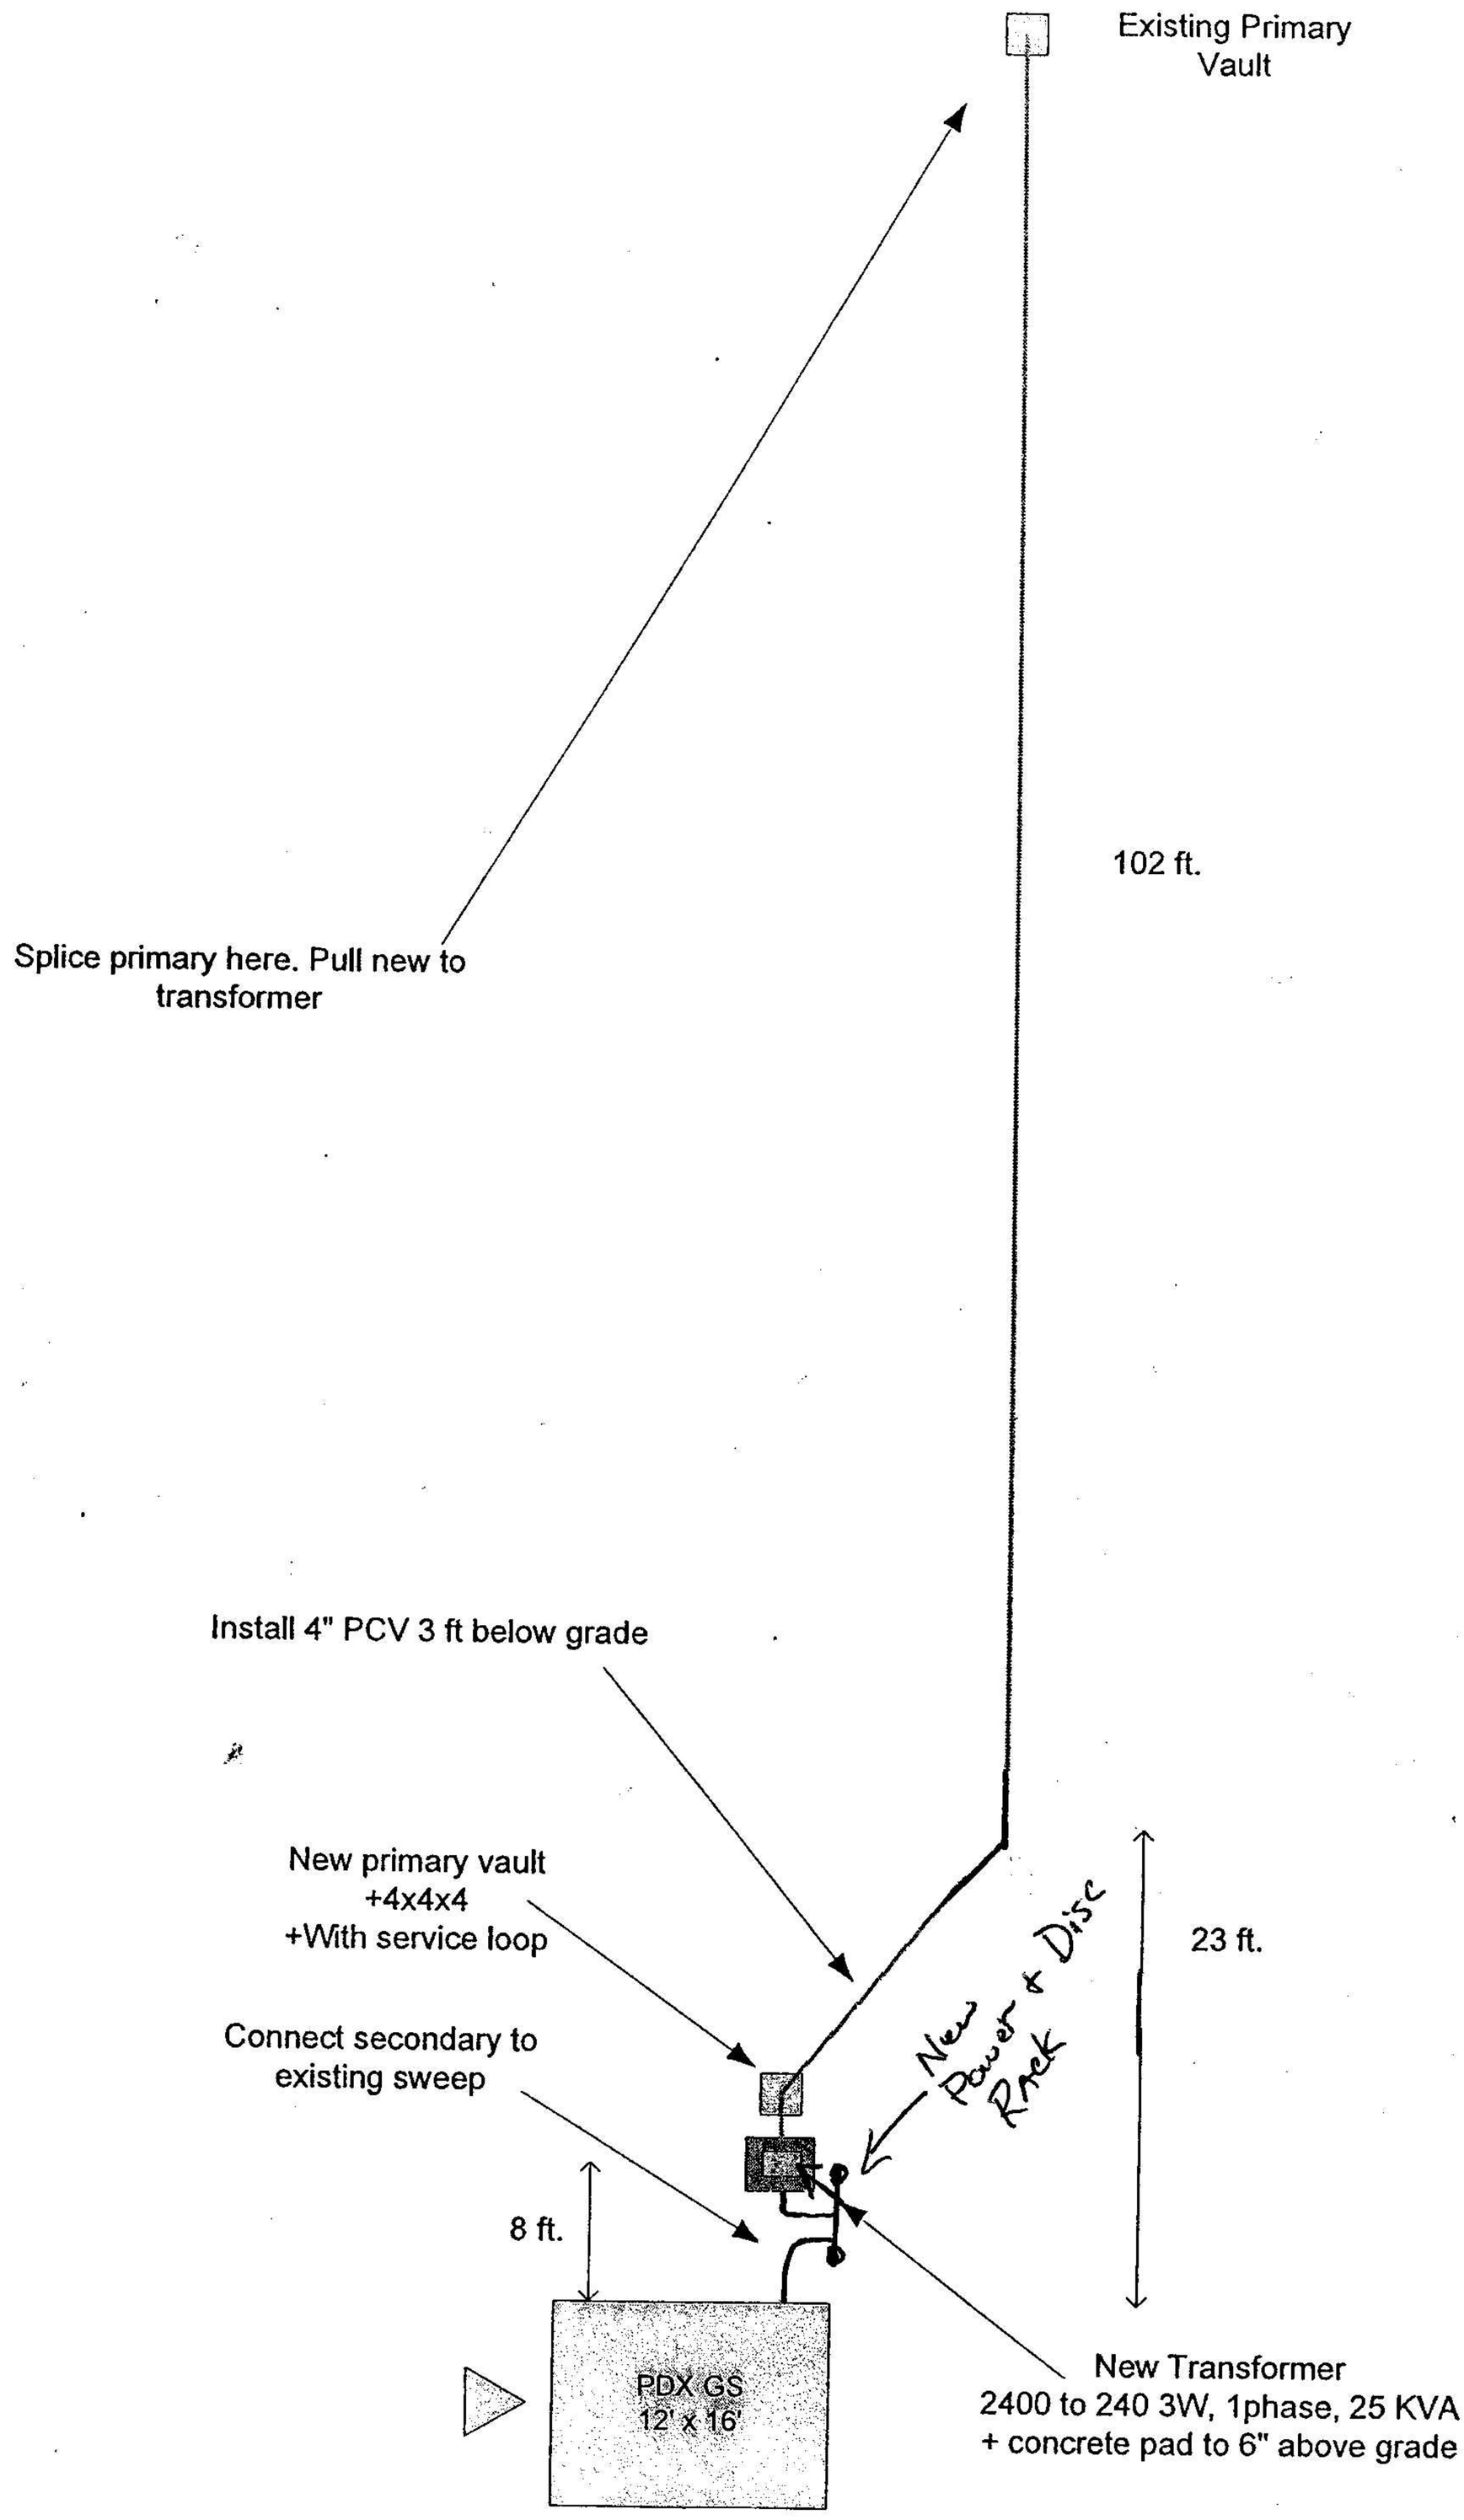
Existing Primary
Vault
102 ft.
Splice primary here. Pull new to
transformer
Install 4" PCV 3 ft below grade
New primary vault
+4x4x4
+With service loop
Connect secondary to
existing sweep
New Power & Disc
Rack
23 ft.
8 ft.
PDX GS
12' x 16'
New Transformer
2400 to 240 3W, 1phase, 25 KVA
+ concrete pad to 6" above grade