NOTES:

1. ESS TO BE BARE 4/0 AWG COPPER CABLE 19 STRAND
2. BURY COPPER CABLE AT LEAST 2 FEET DEEP
3. ALL DIMENSIONS APPROXIMATE

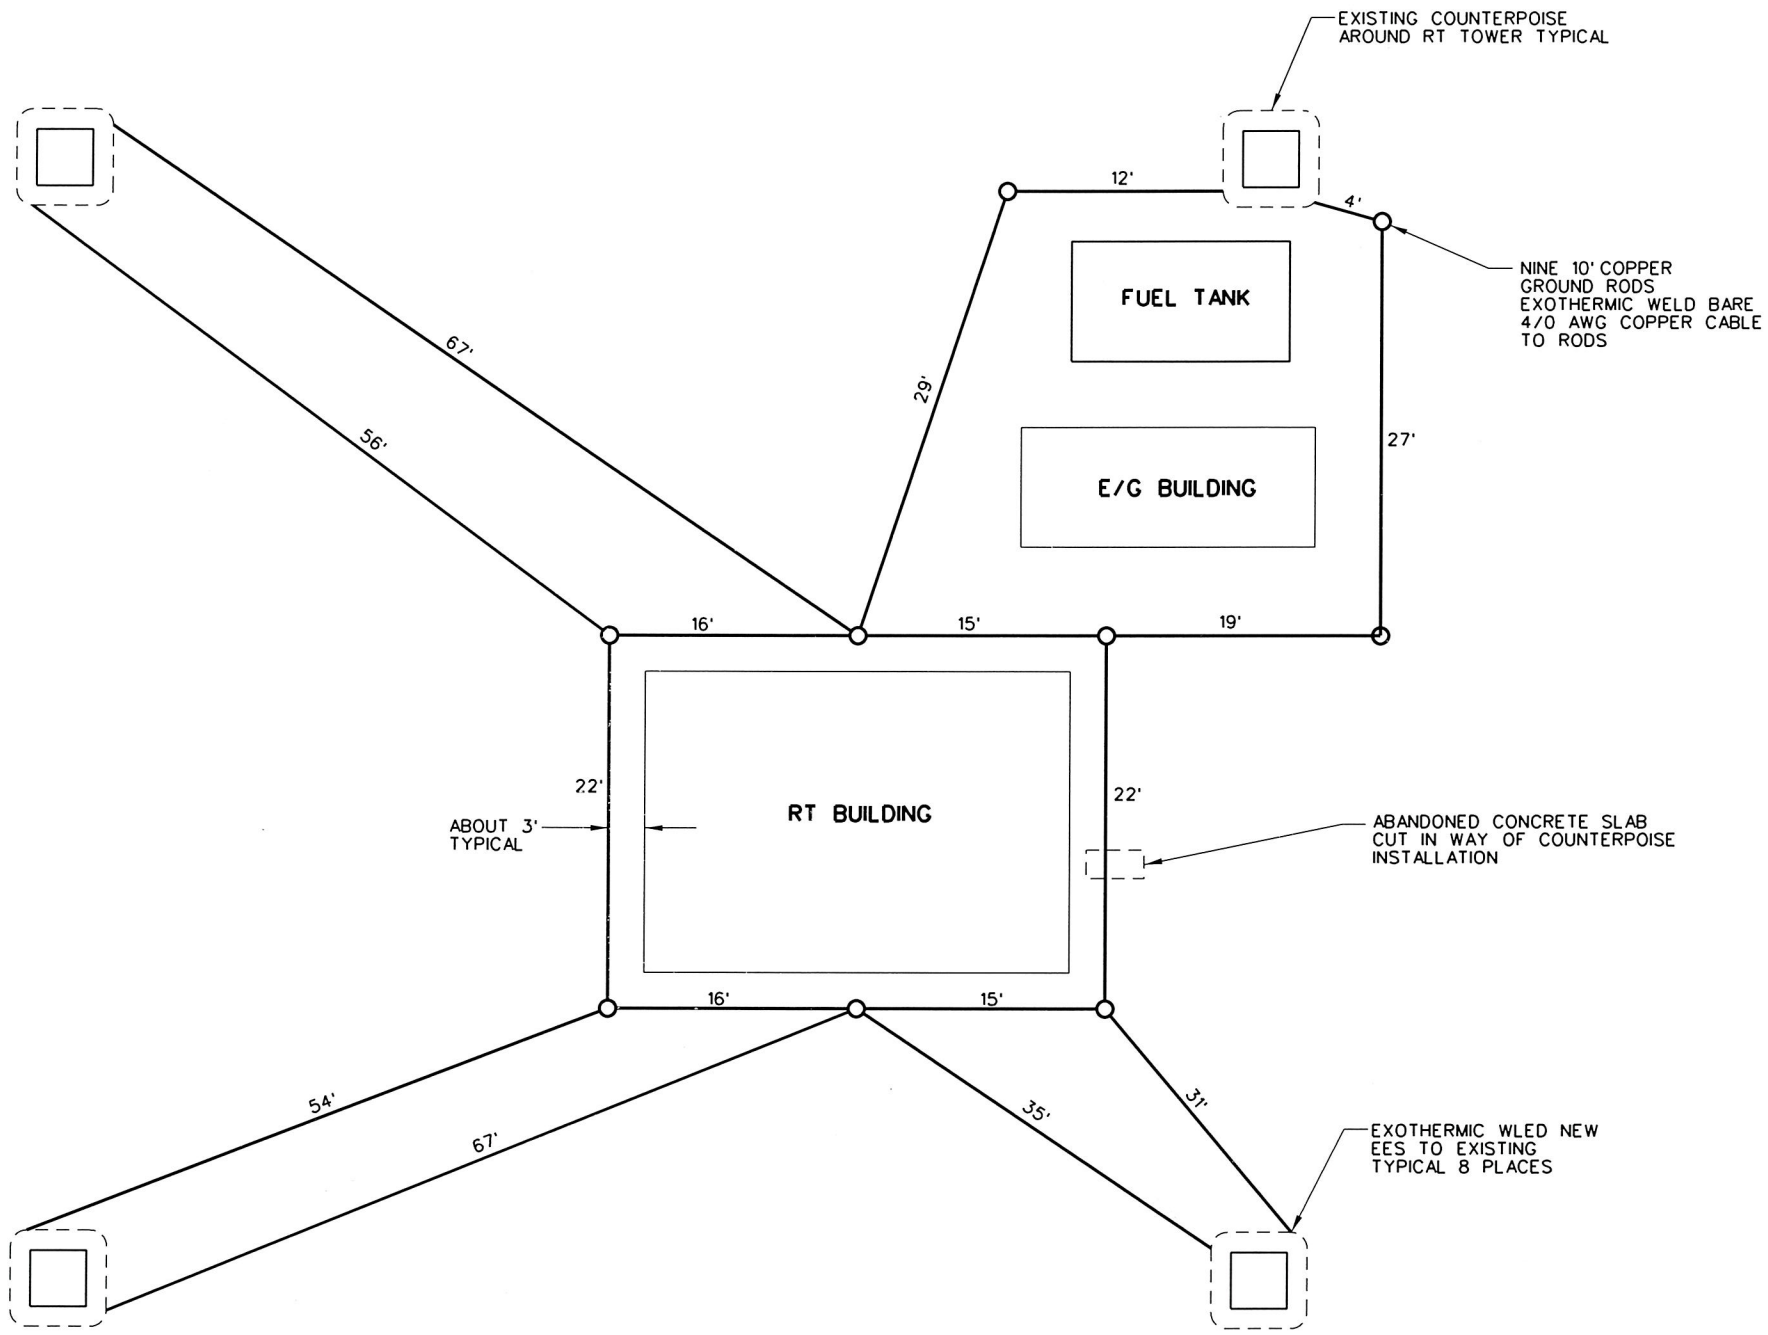

REV	APPROVED DATE	DESCRIPTION	JCN	REDLINE DATE	APVD

DEPARTMENT OF TRANSPORTATION
FEDERAL AVIATION ADMINISTRATION
ATO - TECHNICAL OPERATIONS **WESTERN SERVICE AREA**

FOTS

PALM SPRINGS RT
EARTH ELECTRODE
SYSTEM INSTALLATION

PALM SPRINGS CA

REVIEWED BY	SUBMITTED BY: STEVE WIYAMOTO	APPROVED BY: HANI KHALIL	
	PROJECT ENGINEER	MGR: ENGINEERING - LA	
DESIGNED SM	ISSUED BY: ENGINEERING SERVICES TERMINAL	DATE 10/30/2009	JCN 805330
DRAWN OT		DRAWING NO PSP-D-FOTS-E001	REV
CHECKED SM			

psp-d-fots-e001.dgn Julie CTR Fuangloo
12/31/2009 9:00:41 AM